



CONTROLBOX OVERB.1000 5,5KW


Projekt: ESBB055000
Datum : 22-5-2008


										GROUP : 01		2	
	DATE : 22-5-2008		DRAWN BY : PAJ		MANUFACTURER:		CUSTOMER :				DRAWING.NR.: ESBB055000		PAGE : 1
	MOD. : 10-12-12		C	PAJ	TNR		PROJECT : CONTROLBOX OVERB.1000 5,5KW				ORD.NR. : OR:123525		
	MOD. :				PROJ.NR.: 12107184		SUBJECT : Titel				CHECK :		


3


GROUP : 01	4
------------	---

	DATE : 22-5-2008	DRAWN BY : PAJ		MANUFACTURER:	CUSTOMER :	DRAWING.NR.: ESB055000	PAGE : 3
	MOD. : 10-12-12	C	PAJ	TNR	PROJECT : CONTROLBOX OVERB.1000 5,5KW	ORD.NR. : OR:123525	
	MOD. :			PROJ.NR.: 12107184	SUBJECT : Page Overview	CHECK :	TOTAL PAGES : 15

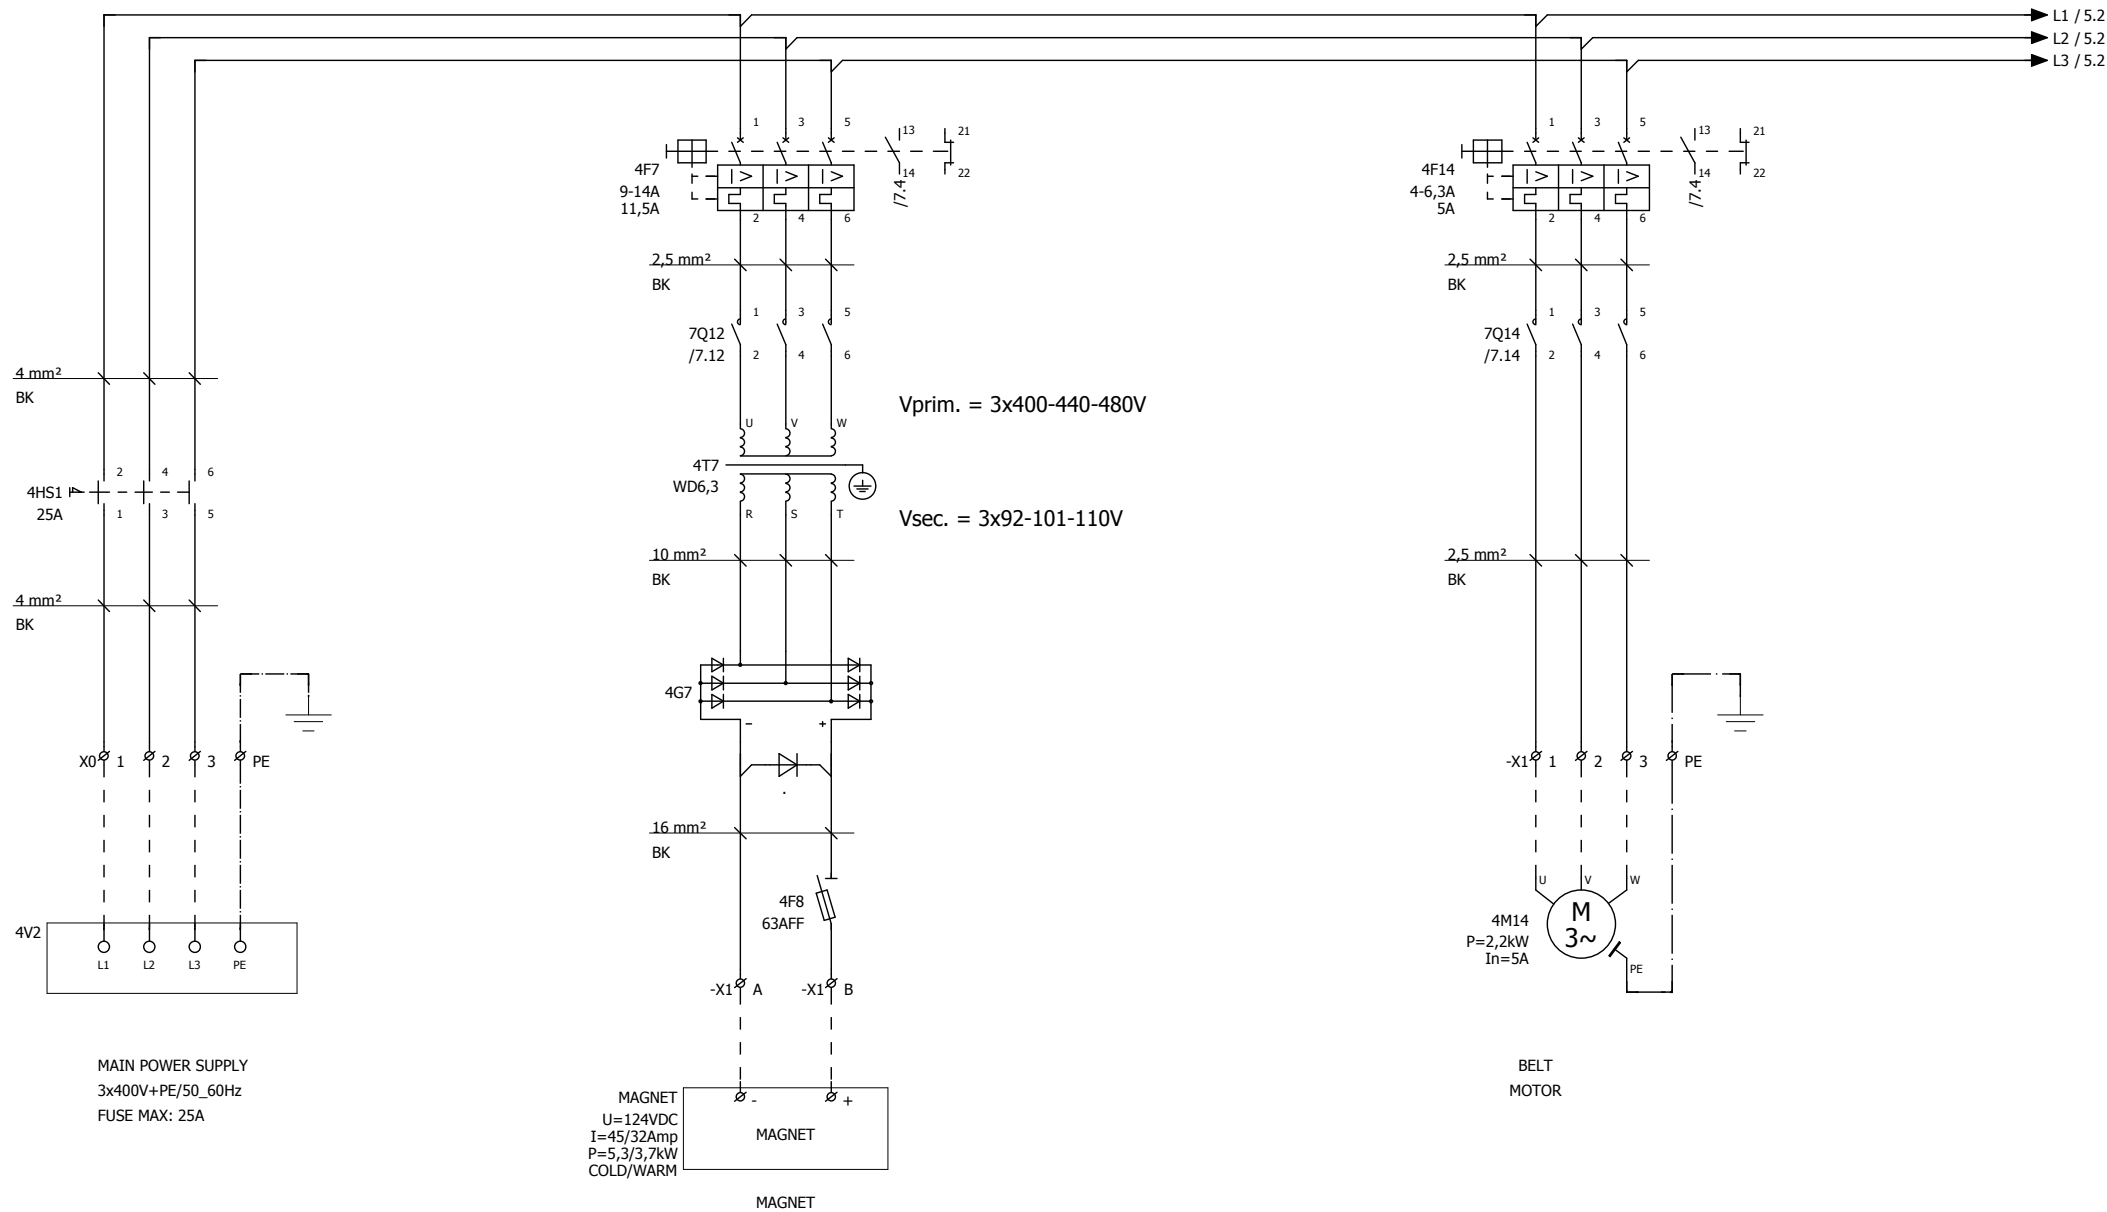

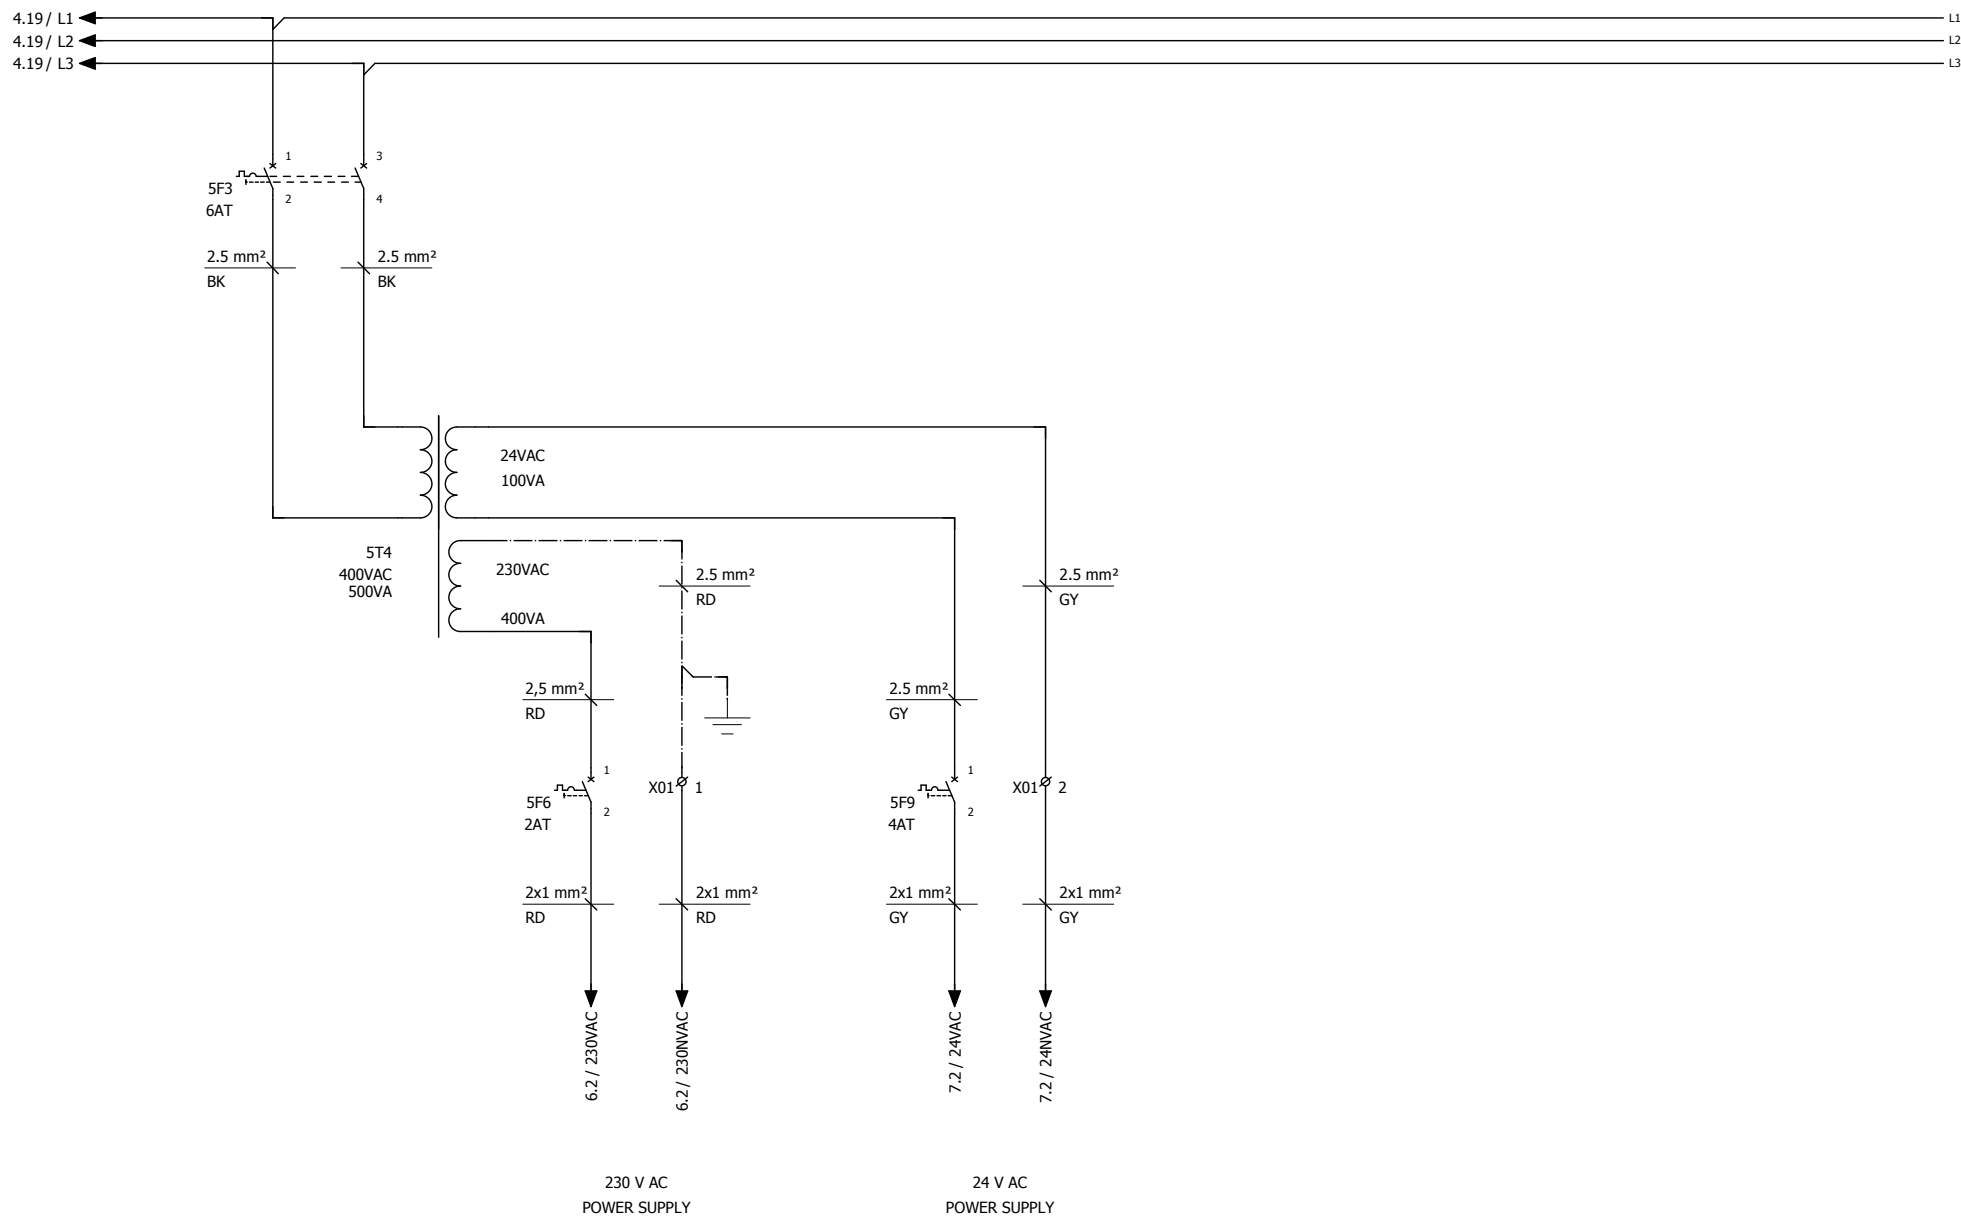

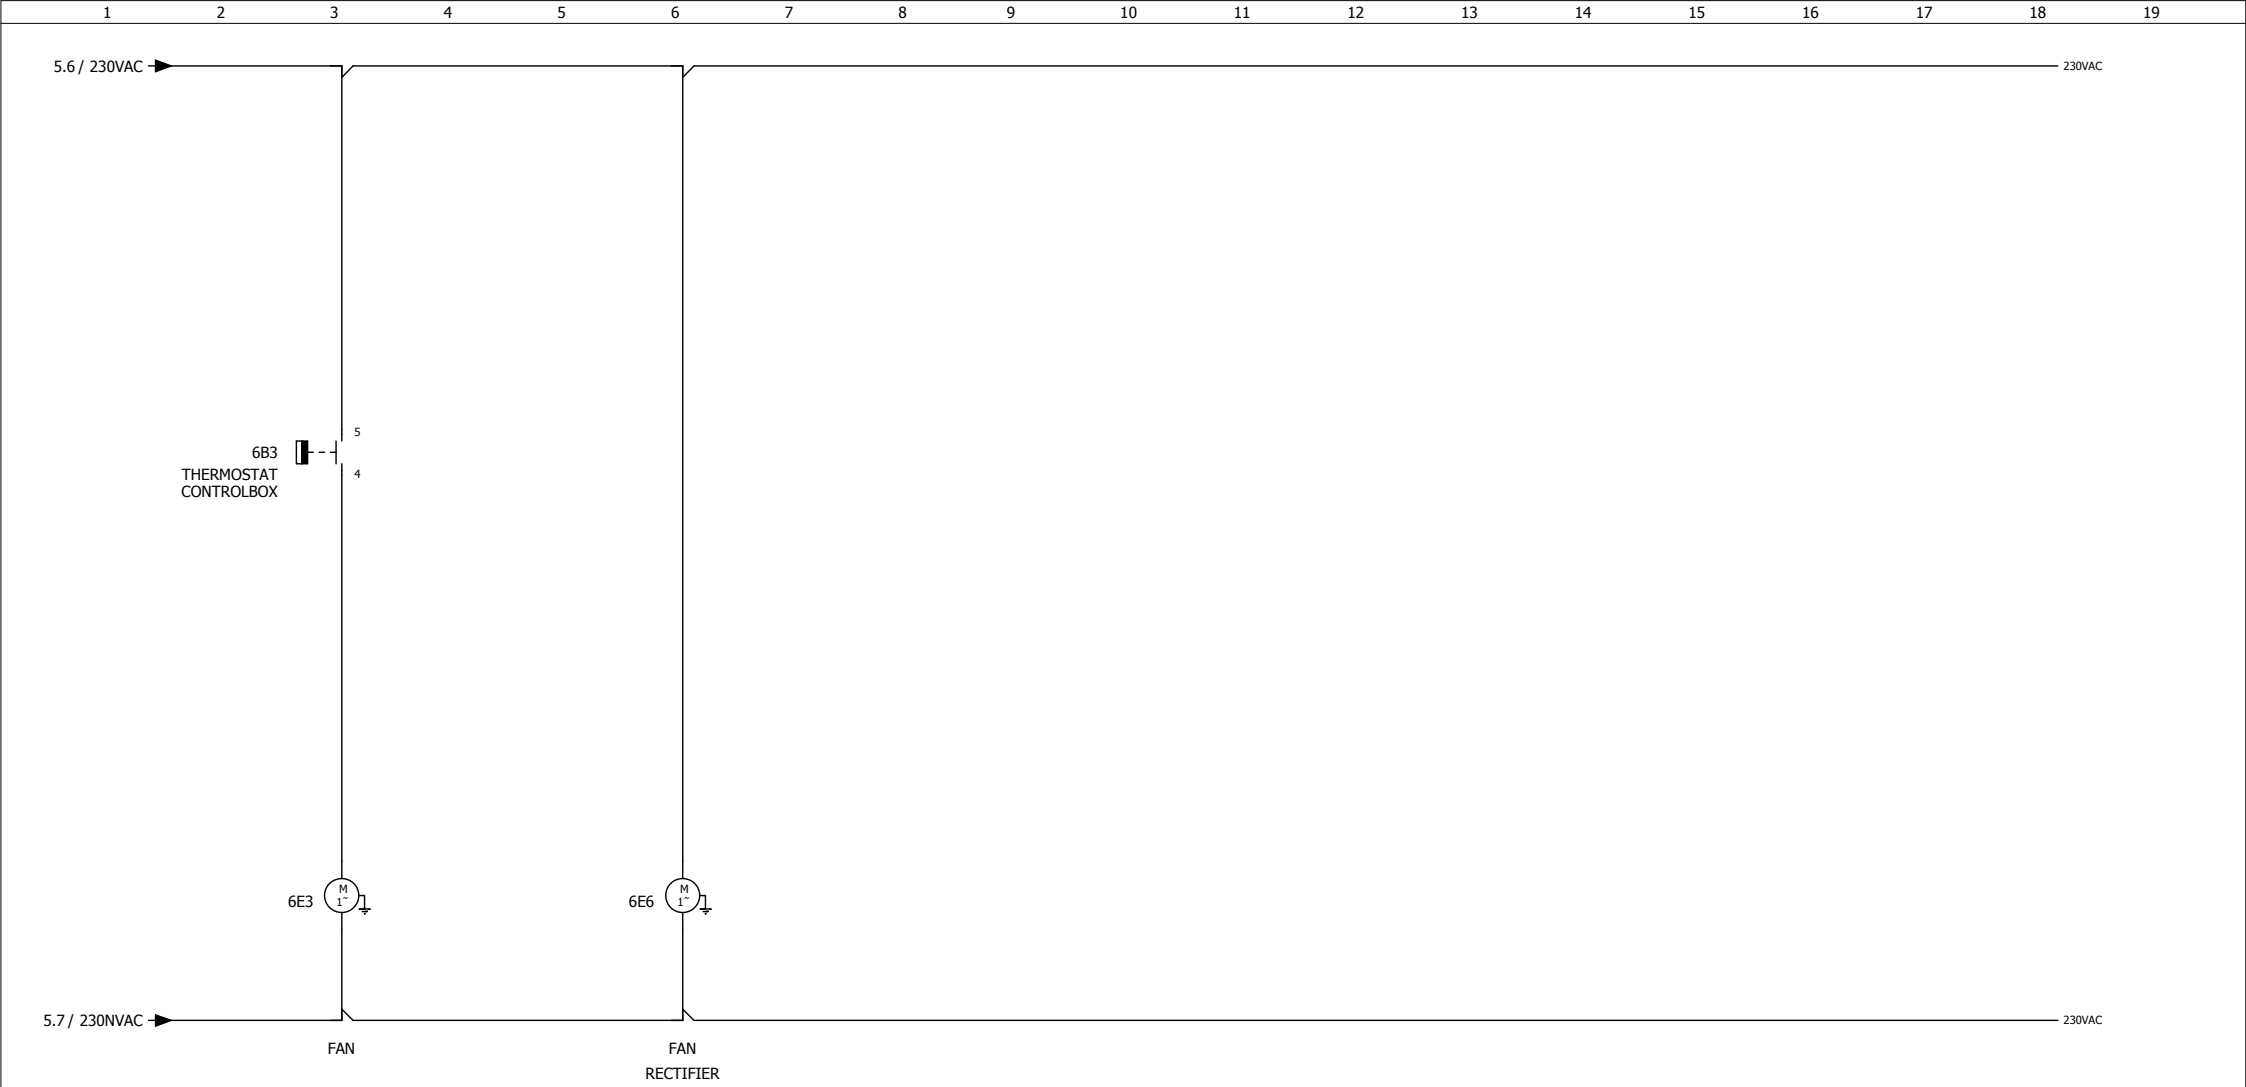

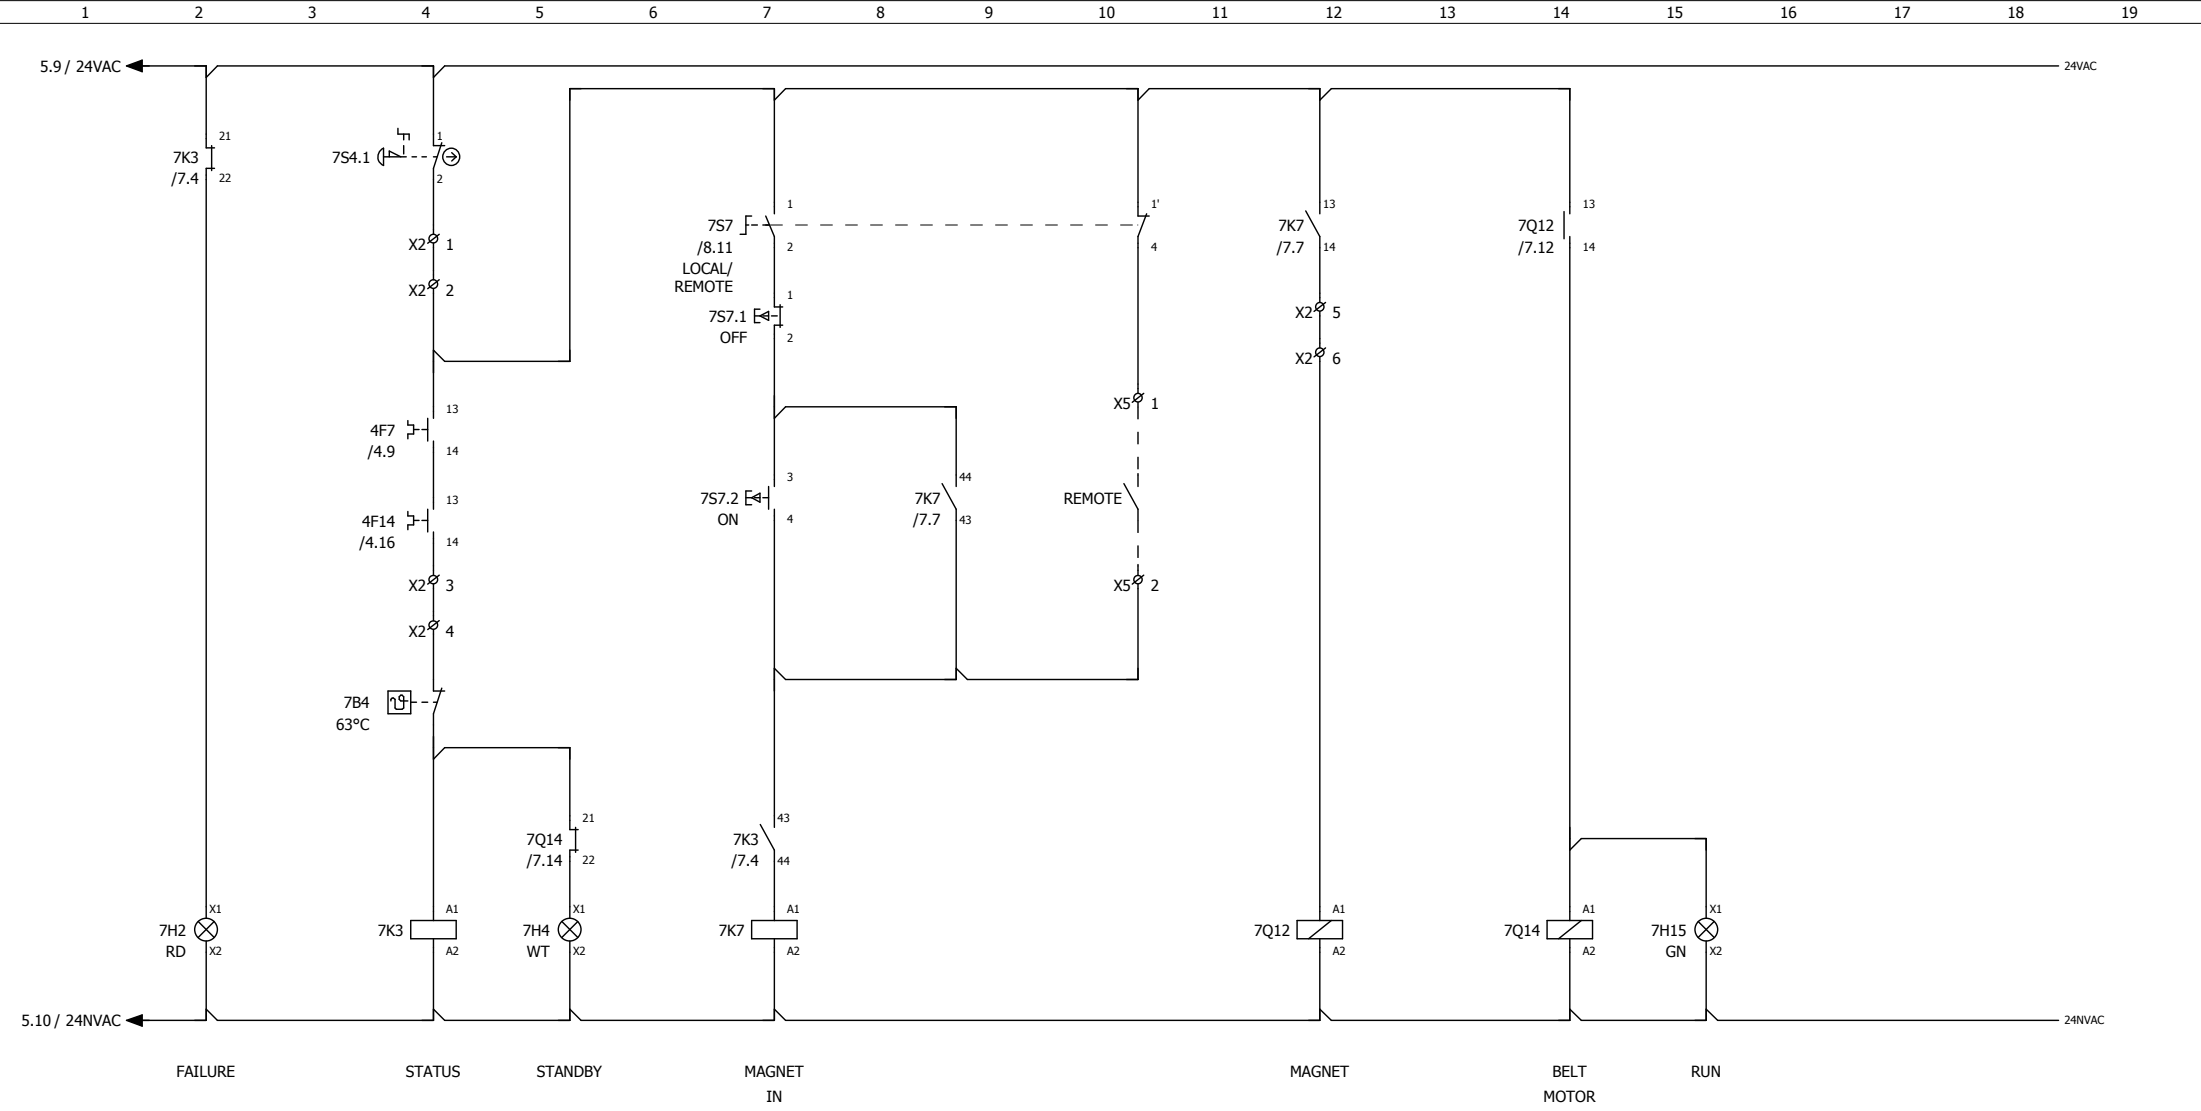

TEL.CAD32-B7
13 - 14 /8.6
21 - 22 /7.2
31 - 32 /8.8
43 - 44 /7.7

TEL.CAD32-B7
13 - 14 /7.12
44 - 43 /7.9


TEL.LC1-D18-B7
1 - 2 /4.7
3 - 4 /4.8
5 - 6 /4.8
13 - 14 /7.14
21 - 22 /8.5




TEL.LC1-D09-B7
1 - 2 /4.14
3 - 4 /4.15
5 - 6 /4.15
13 - 14 /8.9
21 - 22 /7.5

DATE :	22-5-2008	DRAWN BY :	PAJ	MANUFACTURER:
MOD. :	10-12-12	C	PAJ	TNR
MOD. :				PROJ.NR.: 12107184

CUSTOMER :		DRAWING.NR.:	ESBB055000
PROJECT :	CONTROLBOX OVERB.1000 5,5KW	ORD.NR. :	OR:123525
SUBJECT :	Control Circuit	CHECK :	

GROUP :	01	8
PAGE :	7	
TOTAL PAGES :	15	

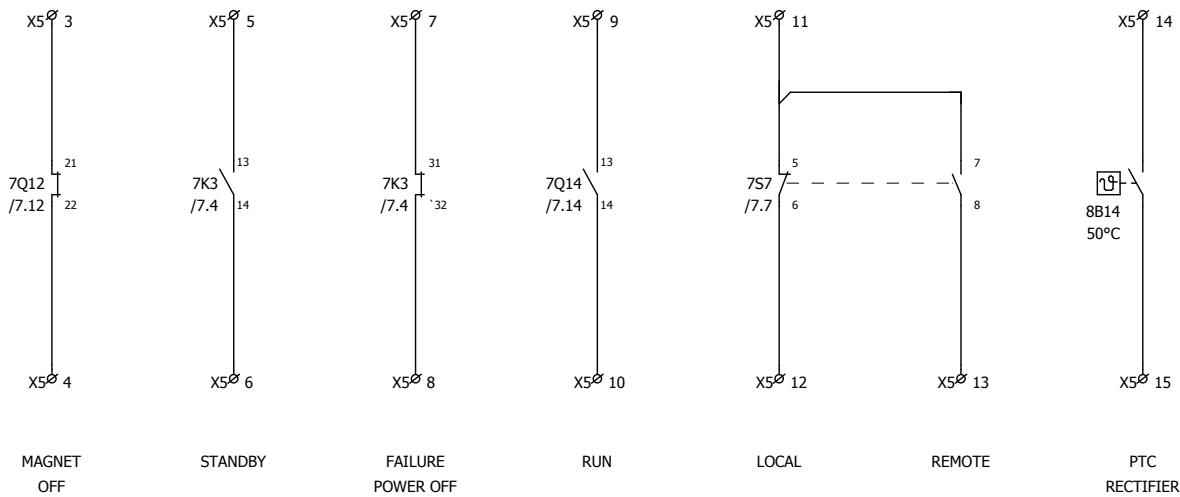

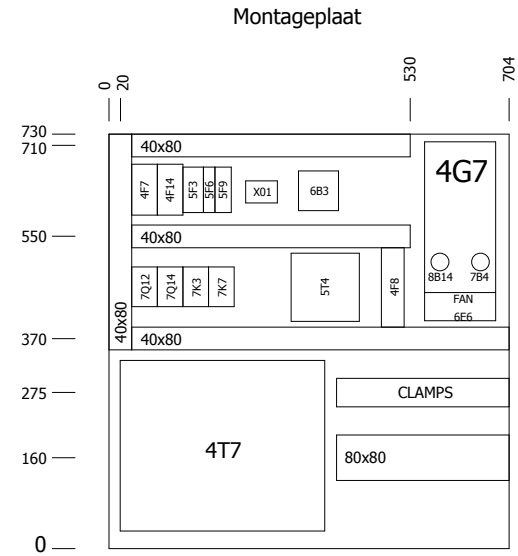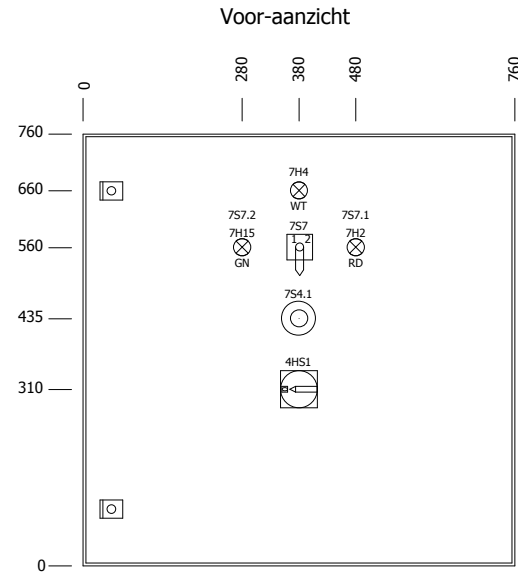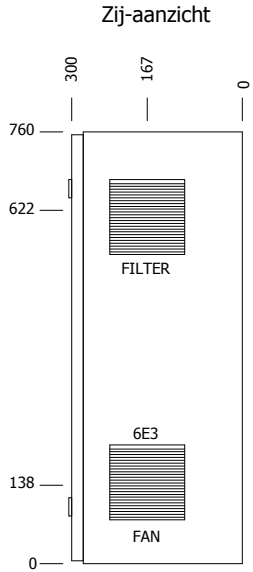

KASTTYPE :
AE1073.500

GROUP : 01 10

9

	DATE : 22-5-2008	DRAWN BY : PAJ		MANUFACTURER:	CUSTOMER :	DRAWING.NR.: ESB055000	PAGE : 10
	MOD. : 10-12-12	C	PAJ	TNR	PROJECT : CONTROLBOX OVERB.1000 5,5KW	ORD.NR. : OR:123525	
	MOD. :			PROJ.NR.: 12107184	SUBJECT : =01-X0	CHECK :	TOTAL PAGES : 15

10

	DATE : 22-5-2008	DRAWN BY : PAJ		MANUFACTURER:	CUSTOMER :	DRAWING.NR.: ESB055000	PAGE : 11
	MOD. : 10-12-12	C	PAJ	TNR	PROJECT : CONTROLBOX OVERB.1000 5,5KW	ORD.NR. : OR:123525	
	MOD. :				PROJ.NR.: 12107184	SUBJECT : =01-X1	CHECK :

11

12

MATERIALLIST

PART NUMBER	TOT.	TYPE	DISCRIPTION	MANUFACTOR	ORDERING CODE	CODE GOUDSMIT	VOLTAGE	PAGE/PATH
=01-4HS1	1	H226-41300-033N4	Main Switch 25A	Salzer	H226-41300-033N4		0	=01/4.2
=01-4F7	1	GV2-RT16	Motor protection switch (9 - 14)	Telemecanique	GV2-RT16		0	=01/4.7
=01-4F7	1	GV-AE11	Auxiliary contact block 1xNO 1xNC	Telemecanique	GV-AE11		0	=01/4.7
=01-4T7	1	WD6,3	Transformer 3*400-440-480/3*92-101-110Vac	Jaspers	WD6,3	EIJJ26K303	0	=01/4.7
=01-4G7	1	B6U 500/670-120 FCT	Rectifier	Semikron	B6U 500/670-120 FCT	EIKCDB3803	0	=01/4.7
=01-4F8	1	3NH3030	Fuse holder 1P	Siemens	3NH3030	EIHE091001	0	=01/4.8
=01-4F8	1	3NE8018	Fuse link 63AFF	Siemens	3NE8018	EIHF070101	0	=01/4.8
=01-4F14	1	GV2-ME10	Motor protection switch (4 - 6.3)	Telemecanique	GV2-ME10		0	=01/4.14
=01-4F14	1	GV-AE11	Auxiliary contact block 1xNO 1xNC	Telemecanique	GV-AE11		0	=01/4.14
=01-5F3	1	24267	Circuit breaker 2P 6AT	Merlin Gerin	24267		0	=01/5.3
=01-5T4	1	VE05	Transformer 500VA	Jaspers	VE05		0	=01/5.4
=01-5F6	1	24236	Circuit breaker 1P 2AT	Merlin Gerin	24236		0	=01/5.6
=01-5F9	1	24238	Circuit breaker 1P 4AT	Merlin Gerin	24238		0	=01/5.9
=01-6B3	1	SK3110.000	Thermostat	Rittal	SK3110.000			=01/6.3
=01-6E3	1	SK3322.107	Fan 19 Watt	Rittal	SK3322.107			=01/6.3
=01-6E3	1	SK3322.207	Filter	Rittal	SK3322.207			=01/6.3
=01-7S4.1	1	ZB4-BS54	Emergency stop	Telemecanique	ZB4-BS54		0	=01/7.4
=01-7S4.1	1	ZB4-BZ102	NC Contact	Telemecanique	ZB4-BZ102		0	=01/7.4
=01-7S4.1	1	ZBY-9530	Emergency stop Tag	Telemecanique	ZBY-9530		0	=01/7.4
=01-7K3	1	CAD32-B7	Auxiliary relay	Telemecanique	CAD32-B7		24VAC	=01/7.4
=01-7H4	1	ZB4-BV013	Pilot light white	Telemecanique	ZB4-BV013		0	=01/7.5
=01-7H4	1	ZB4-BVB1	Lamp led white	Telemecanique	ZB4-BVB1		24VDC/AC	=01/7.5
=01-7S7	1	M220-61038-003M1	Selector switch	Salzer	M220-61038-003M1		0	=01/7.7
=01-7S7.1	1	ZB4-BW34	Pushbutton red with indicating light	Telemecanique	ZB4-BW34		0	=01/7.7
=01-7S7.1	1	ZB4-BW062	NC & indicating light	Telemecanique	ZB4-BW062		0	=01/7.7
=01-7S7.2	1	ZB4-BW33	Pushbutton green with indicating light	Telemecanique	ZB4-BW33		0	=01/7.7
=01-7S7.2	1	ZB4-BW061	NO & indicating light	Telemecanique	ZB4-BW061		0	=01/7.7
=01-7K7	1	CAD32-B7	Auxiliary relay	Telemecanique	CAD32-B7		24VAC	=01/7.7
=01-7Q12	1	LC1-D18-B7	Relay 7.5 kW	Telemecanique	LC1-D18-B7		24VAC	=01/7.12
=01-7Q14	1	LC1-D09-B7	Relay 4.0 kW	Telemecanique	LC1-D09-B7		24VAC	=01/7.14
=01-CONTROLBOX	1	AE 1073.500	Controlbox 760 x 760 x 300mm	Rittal	AE 1073.500			=01/9.142
=01-CONTROLBOX	1	SZ2515.000	Drawing holder	Rittal	SZ2515.000			=01/9.142